



FIG. 1

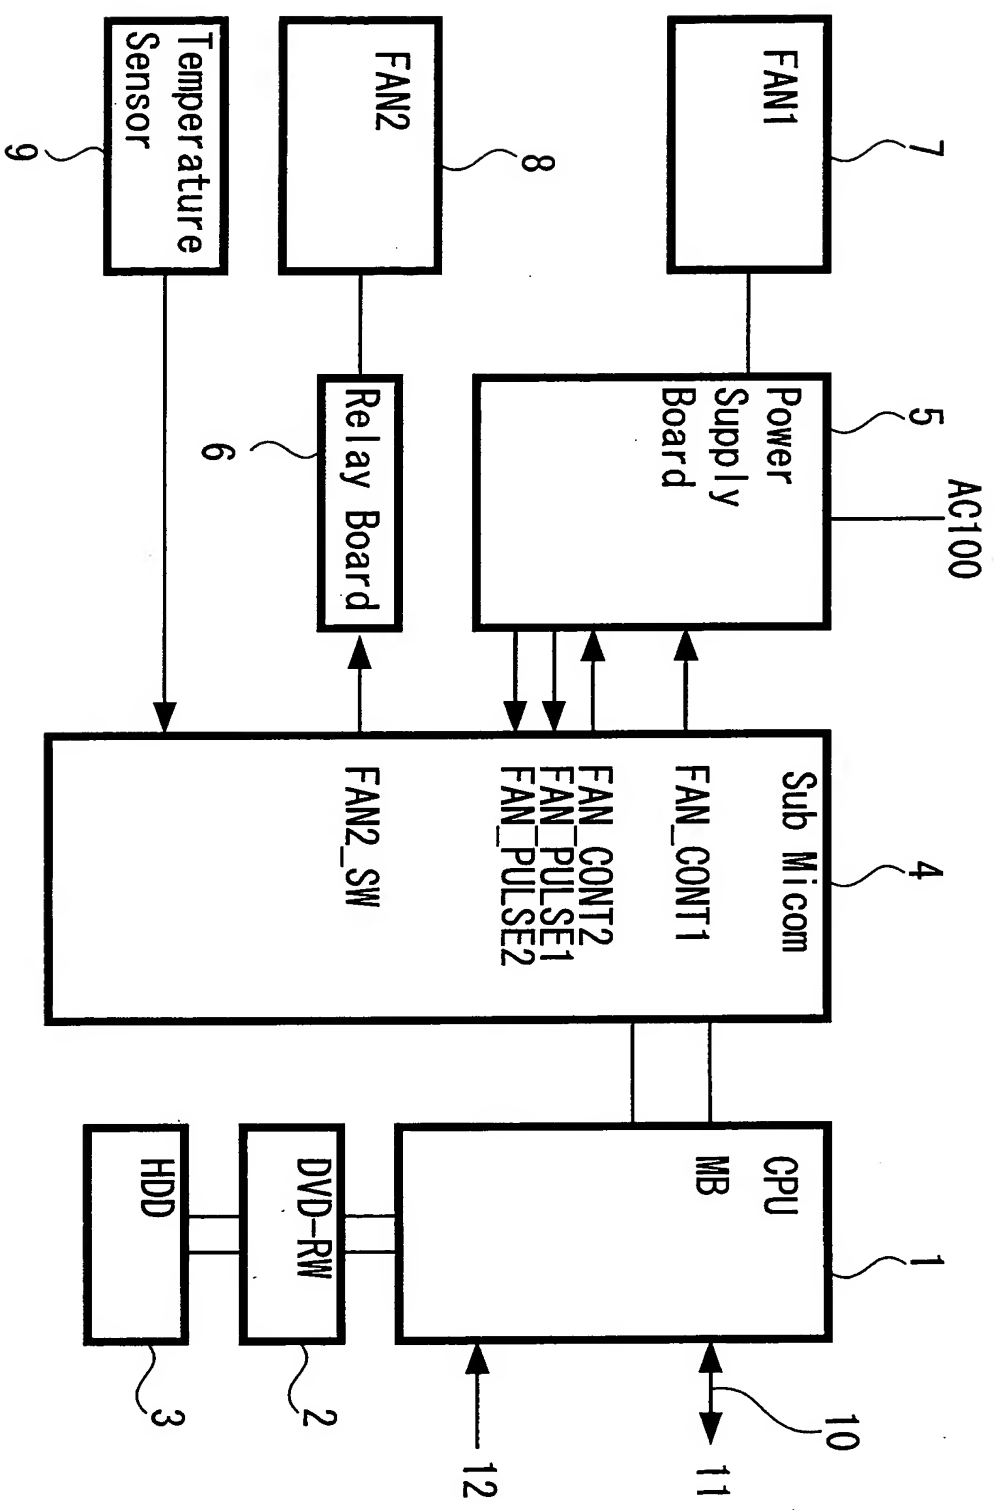

Block diagram showing constitution of fan control system

FIG. 2

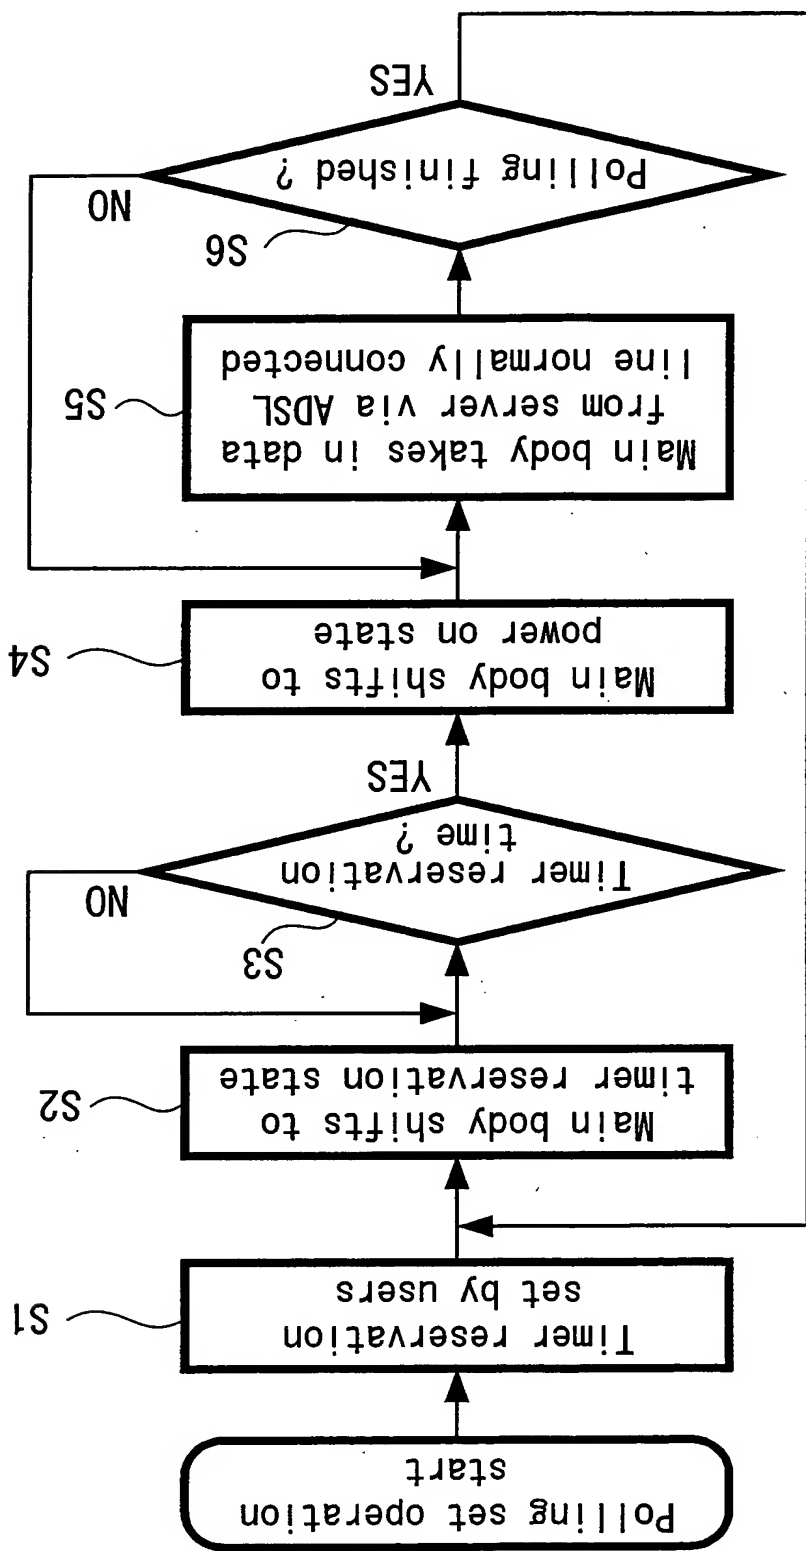

Flowchart showing polling set operation

FIG. 3

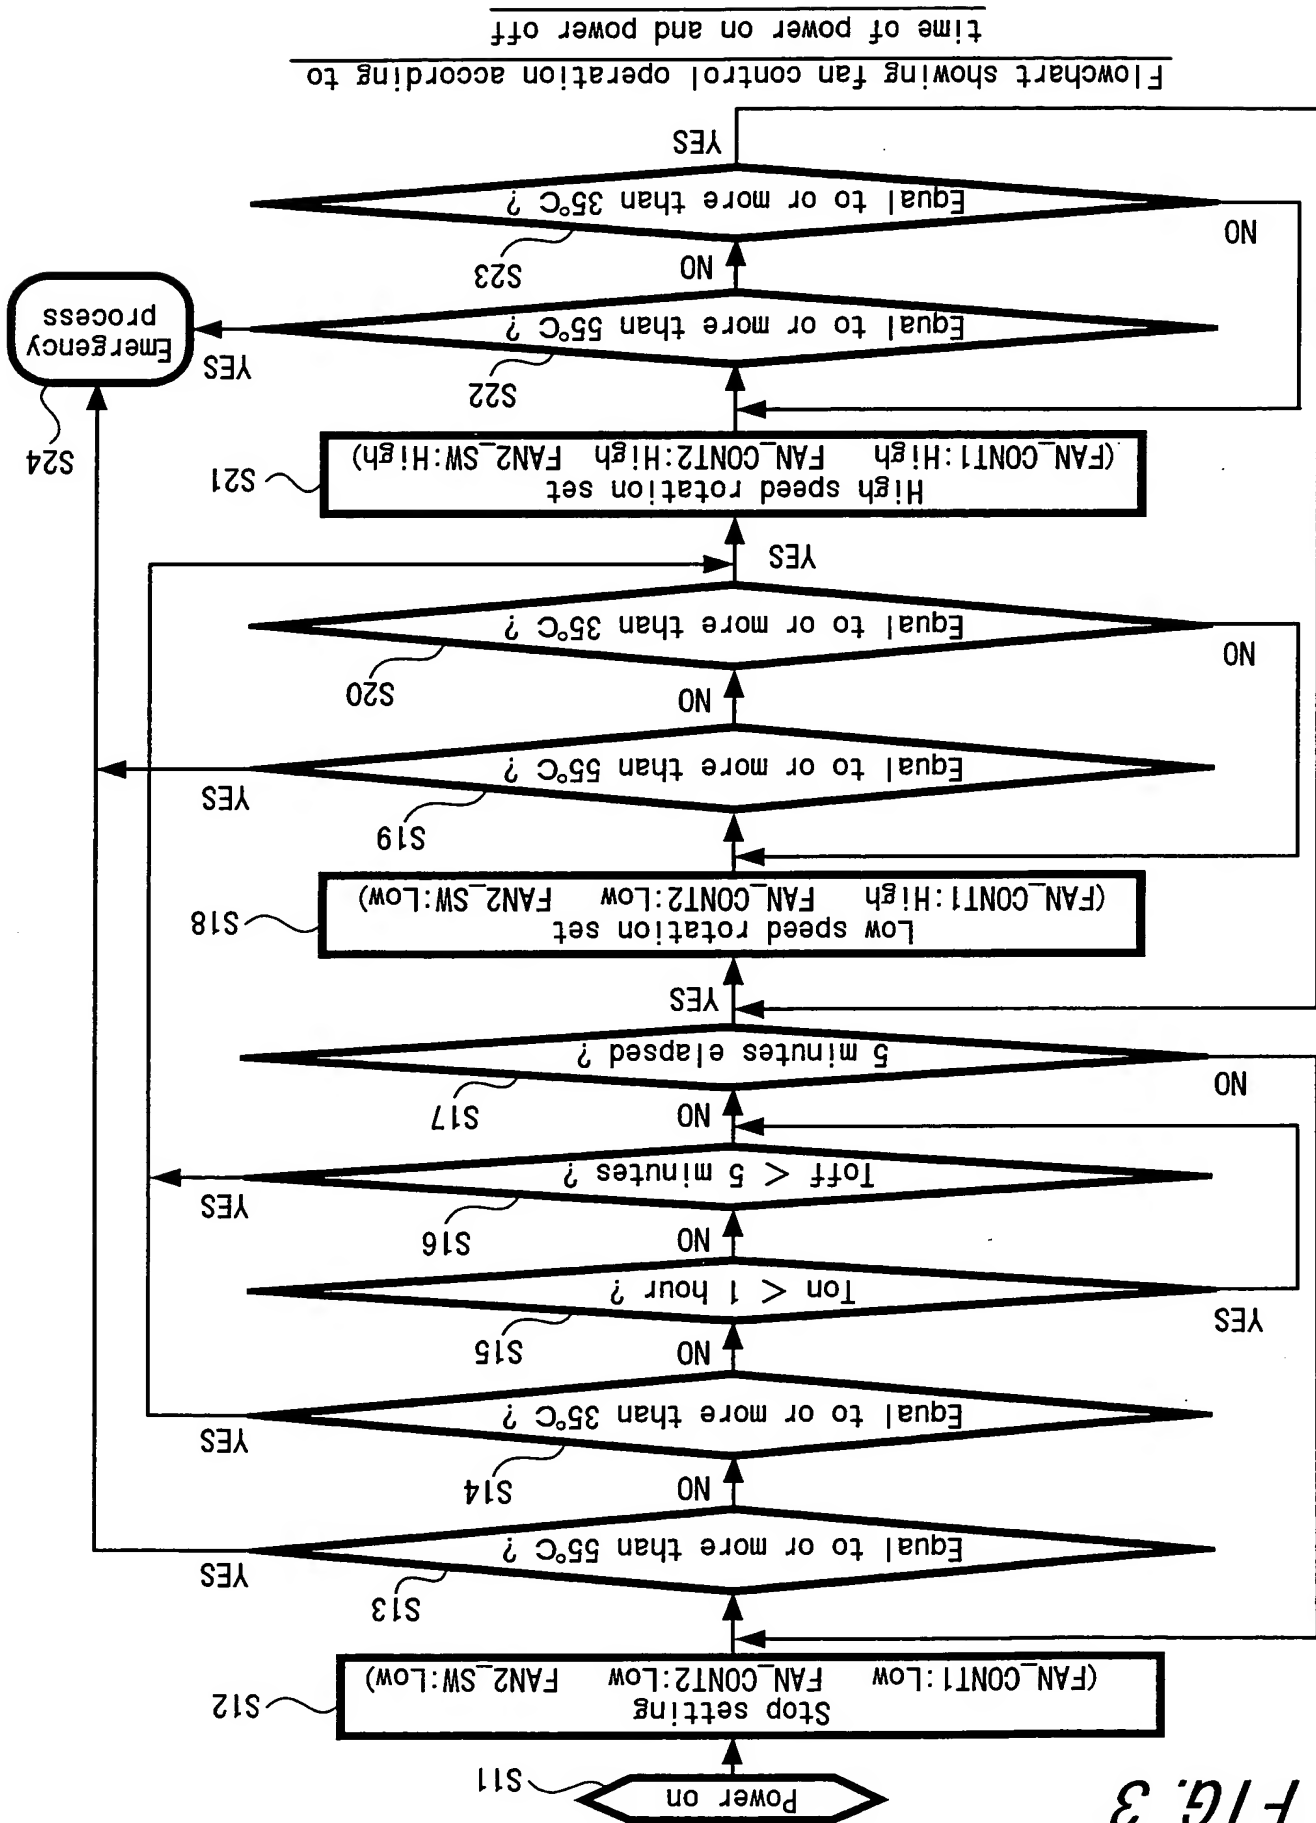


FIG. 4A

Equipment
Internal
Temperature

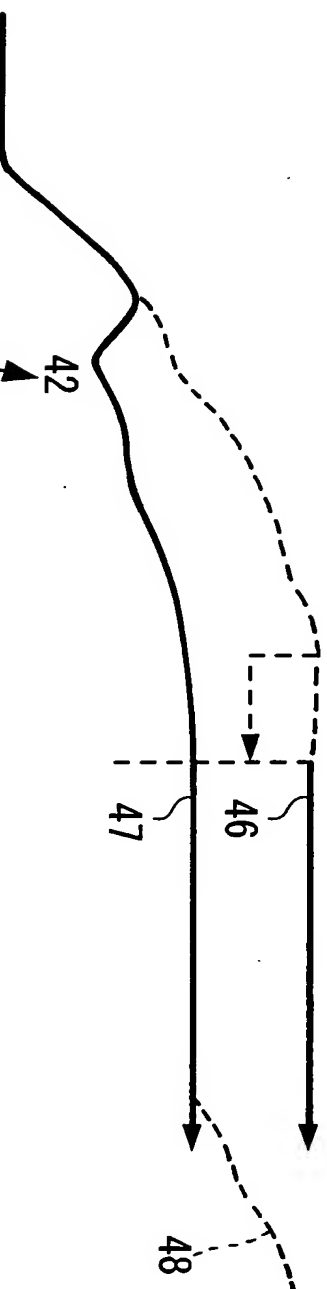


FIG. 4B

Power

On

Off

FAN1

FIG. 4C

Off

40

On

43

45

49

FAN2

44

Polling

H

FIG. 4D

L

T0

T1

T2

T3

T4

T5

T6

T7

T8

T9

T10

T11

Time

→ T [s]

Time charts showing operations

FIG. 5

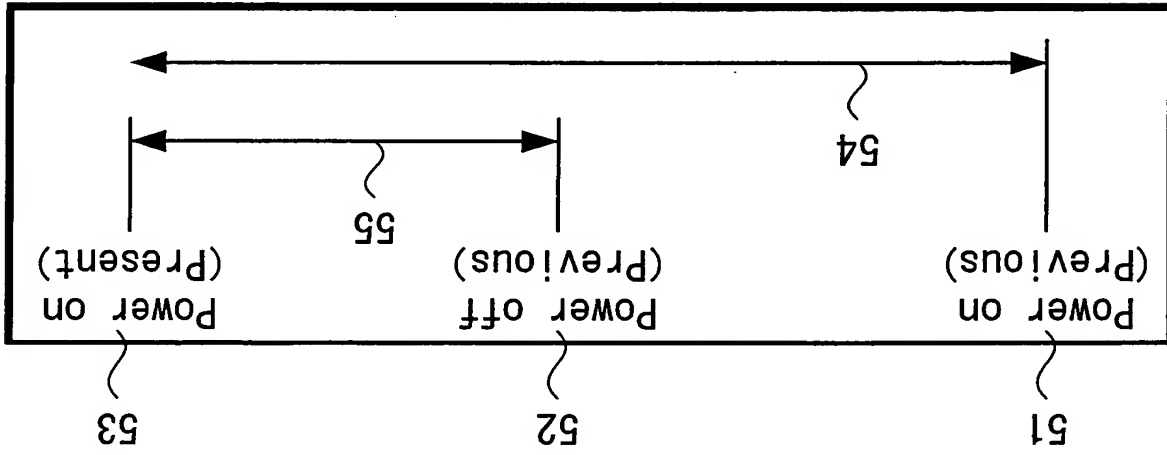


Diagram showing definition of Ton and Toff

FIG. 6

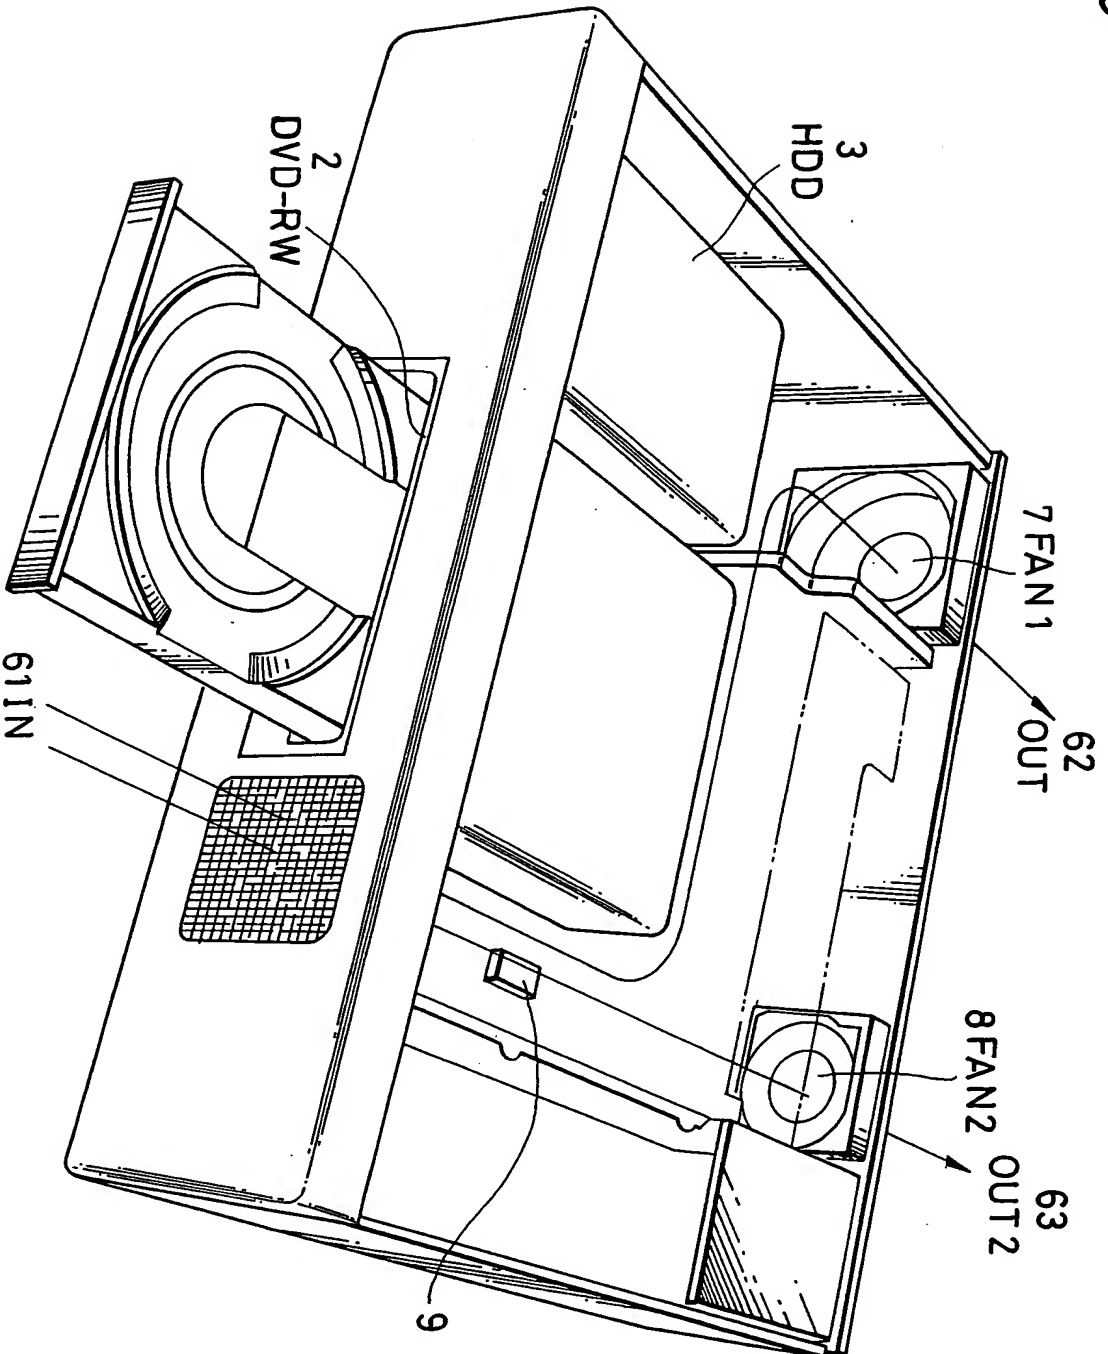


Diagram showing internal arrangement of equipment